


# DETAIL 02713-10 COBB COUNTY WATER SYSTEM FLUSH HYDRANT INSTALLATION

AUGUST 7, 2001

AGENCY DIRECTOR

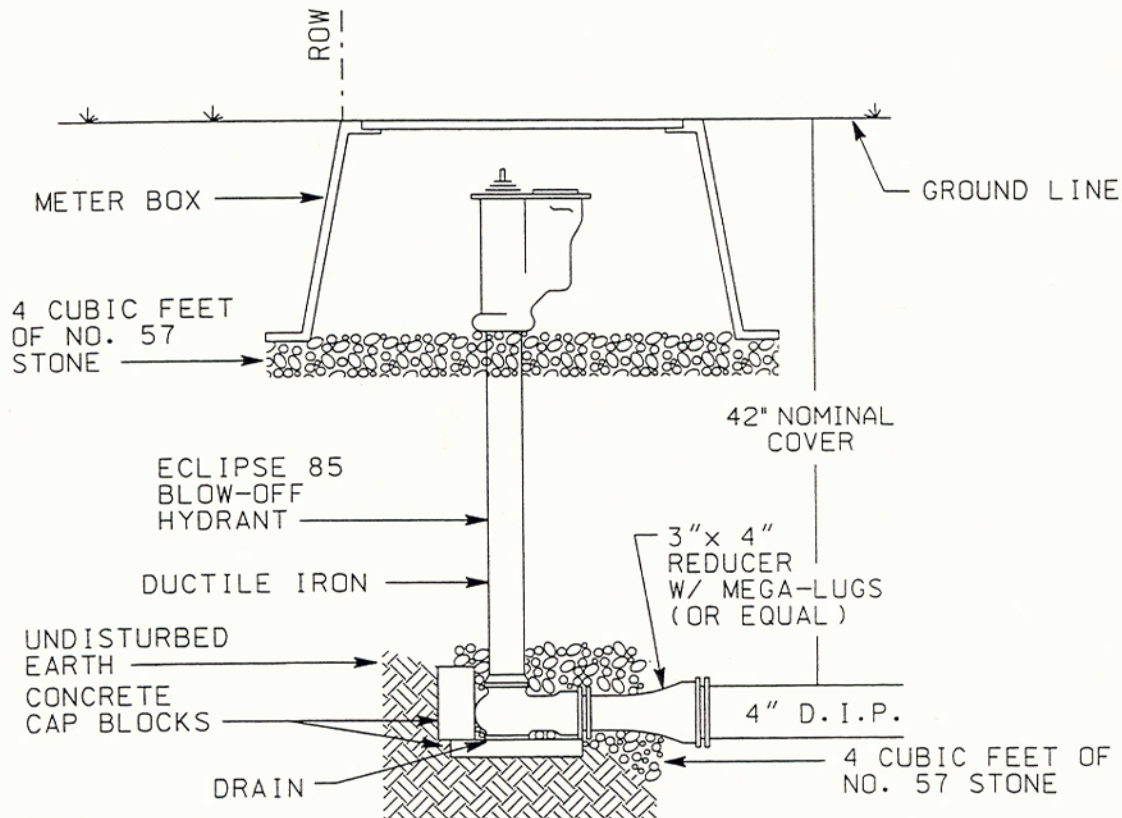

NOTE :

1. BLOW-OFF HYDRANTS SHALL BE ECLIPSE NO. 85 HYDRANT AS MANUFACTURED BY JOHN C. KUPFERLE FOUNDRY COMPANY, ST. LOUIS, MO. OR EQUAL.
2. HYDRANT SHALL BE SELF-DRAINING, NON-FREEZING, COMPRESSION TYPE WITH  $2\frac{3}{16}$ " MAIN VALVE OPENING. INLET CONNECTION SHALL BE 3" M.J.. OUTLET SIZE SHALL BE  $2\frac{1}{2}$ " NST.
3. PRINCIPAL INTERIOR OPERATING PARTS SHALL BE BRASS AND REMOVABLE FROM THE HYDRANT FOR SERVICING WITHOUT EXCAVATING THE HYDRANT.